


# TRANSFORMER PAD SPECIFICATIONS (UP TO 300 KVA)

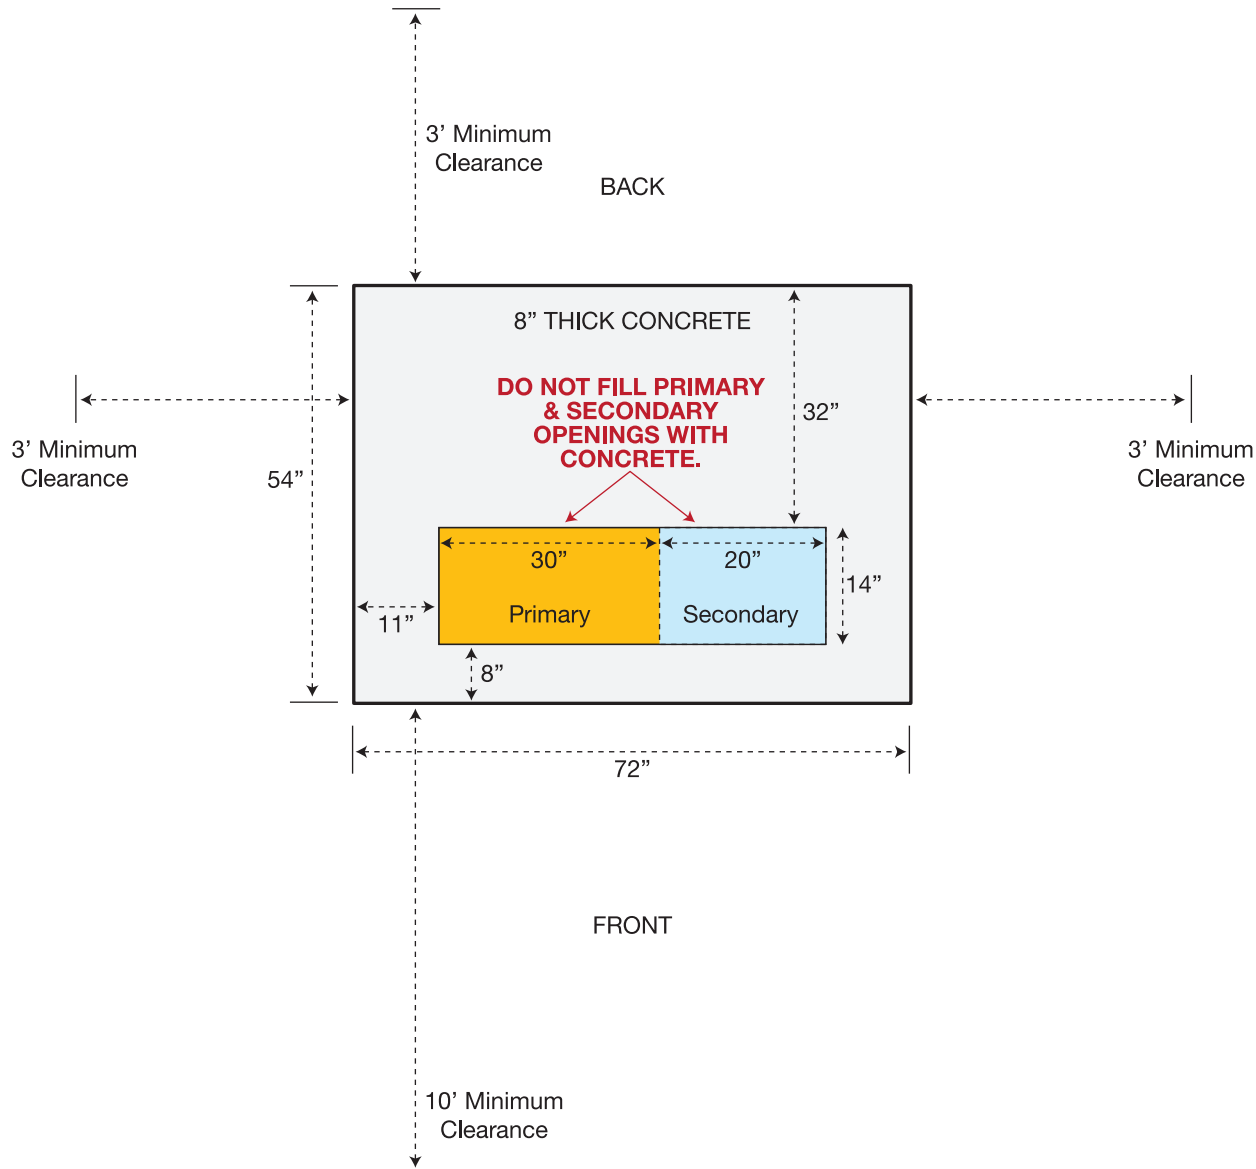

## Primary Side (Southwestern)

Install (2) 4" sweep elbows in primary side (supplied by Southwestern).

## Secondary Side (Member Side)

All secondary conduit must be within 20" x 14" area indicated.

Install member's conduit in member side (sized by member).

**DO NOT FILL PRIMARY & SECONDARY OPENINGS WITH CONCRETE.**

Minimum Clearance: Please keep shrubs and structures 10' away from the side with doors and 3' from other sides.

Please verify pad size and location with engineer before installation.

